

# Regulations Compliance Report

Approved Document L1A, 2013 Edition, England assessed by Stroma FSAP 2012 program, Version: 1.0.4.16  
Printed on 25 March 2019 at 14:47:55

## Project Information:

**Assessed By:** Aymon Winter (STRO014511)

**Building Type:** Flat

## Dwelling Details:

### NEW DWELLING DESIGN STAGE

Total Floor Area: 65.73m<sup>2</sup>

**Site Reference :** 49-51 Beulah Hill

**Plot Reference:** 01-19-73120 A-G-02 PL1

**Address :** A-G-02, 49-51 Beulah Hill

Sada Unit Ref: A0-A6

## Client Details:

**Name:** Sada Architecture

**Address :**

**This report covers items included within the SAP calculations.**

**It is not a complete report of regulations compliance.**

## 1a TER and DER

Fuel for main heating system: Mains gas

Fuel factor: 1.00 (mains gas)

Target Carbon Dioxide Emission Rate (TER) 21.41 kg/m<sup>2</sup>

Dwelling Carbon Dioxide Emission Rate (DER) 16.57 kg/m<sup>2</sup> **OK**

## 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE) 63.2 kWh/m<sup>2</sup>

Dwelling Fabric Energy Efficiency (DFEE) 60.9 kWh/m<sup>2</sup> **OK**

## 2 Fabric U-values

Element	Average	Highest	
External wall	0.16 (max. 0.30)	0.23 (max. 0.70)	<b>OK</b>
Party wall	0.00 (max. 0.20)	-	<b>OK</b>
Floor	0.11 (max. 0.25)	0.13 (max. 0.70)	<b>OK</b>
Roof	0.14 (max. 0.20)	0.14 (max. 0.35)	<b>OK</b>
Openings	1.40 (max. 2.00)	1.40 (max. 3.30)	<b>OK</b>

## 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

## 3 Air permeability

Air permeability at 50 pascals	5.00 (design value)	
Maximum	10.0	<b>OK</b>

## 4 Heating efficiency

Main Heating system:	Database: (rev 440, product index 017558): Boiler systems with radiators or underfloor heating - mains gas Brand name: Worcester Model: Greenstar Model qualifier: 34CDi Classic ErP (Combi) Efficiency 89.1 % SEDBUK2009 Minimum 88.0 %	<b>OK</b>
Secondary heating system:	None	

# Regulations Compliance Report

## 5 Cylinder insulation

Hot water Storage: No cylinder

## 6 Controls

Space heating controls: Programmer, room thermostat and TRVs **OK**

Hot water controls: No cylinder

No cylinder

Boiler interlock: Yes **OK**

## 7 Low energy lights

Percentage of fixed lights with low-energy fittings: 100.0%  
Minimum: 75.0% **OK**

## 8 Mechanical ventilation

Continuous extract system  
Specific fan power: 0.15  
Maximum: 0.7 **OK**

## 9 Summertime temperature

Overheating risk (Thames valley): Medium **OK**

Based on:

Overshading: Average or unknown  
Windows facing: North East 5.94m<sup>2</sup>  
Windows facing: North West 6.1m<sup>2</sup>  
Windows facing: North East 6.41m<sup>2</sup>  
Windows facing: South East 4.35m<sup>2</sup>  
Ventilation rate: 3.00  
Blinds/curtains: Closed 100% of daylight hours

## 10 Key features

External Walls U-value: 0.13 W/m<sup>2</sup>K  
Party Walls U-value: 0 W/m<sup>2</sup>K  
Floors U-value: 0.11 W/m<sup>2</sup>K  
Photovoltaic array

# Code for Sustainable Homes Report

## For use with Nov 2010 addendum 2014 England



### Assessor and House Details

**Assessor Name:** Aymon Winter **Assessor Number:** STRO014511  
**Property Address:** A-G-02  
 49-51 Beulah Hill

### Buiding regulation assessment

	kg/m <sup>2</sup> /year
TER	21.41
DER	16.57

### ENE 1 Assessment - Dwelling Emission Rate

#### Total Energy Type CO<sub>2</sub> Emissions for Codes Levels 1 - 5

	%	kg/m <sup>2</sup> /year	
DER from SAP 2012 DER Worksheet		16.57	(ZC1)
TER		21.41	
Residual CO <sub>2</sub> emissions offset from biofuel CHP		0	(ZC5)
CO <sub>2</sub> emissions offset from additional allowable electricity generation		0	(ZC7)
Total CO <sub>2</sub> emissions offset from SAP Section 16 allowances		0	
DER accounting for SAP Section 16 allowances		16.57	
% improvement DER/TER	22.6		

#### Total Energy Type CO<sub>2</sub> Emissions for Codes Levels 6

	kg/m <sup>2</sup> /year	
DER accounting for SAP Section 16 allowances	16.57	(ZC1)
CO <sub>2</sub> emissions from appliances, equation (L14)	16.95	(ZC2)
CO <sub>2</sub> emissions from cooking, equation (L16)	2.72	(ZC3)
Net CO <sub>2</sub> emissions	35.2	(ZC8)

#### Result:

**Credits awarded for ENE 1 = 3.2**

**Code Level = 4**

### ENE 2 - Fabric energy Efficiency

**Fabric energy Efficiency: 60.87**

**Credits awarded for ENE 2 = 0**

### ENE 7 - Low or Zero Carbon (LZC) Technologies

#### Reduction in CO<sub>2</sub> Emissions

	%	kg/m <sup>2</sup> /year	
Standard Case CO <sub>2</sub> emissions		43.38	
Standard DER		23.98	
Actual Case CO <sub>2</sub> emissions		37.49	
Actual DER		18.09	
Reduction in CO <sub>2</sub> emissions	13.58		

**Credits awarded for ENE 7 = 1**

Technologies eligible to contribute to achieving the requirements of this issue must produce energy from renewable sources and meet all other ancillary requirements as defined by Directive 2009/28/EC of the European Parliament and of the Council of 23 April 2009 on the promotion of the use of energy from renewable sources and amending and subsequently repealing Directives 2001/77/EC and 2003/30/EC.

The following requirements must also be met:

- Where not provided by accredited external renewables there must be a direct supply of energy produced to the dwelling under assessment.
- Where covered by the Microgeneration Certification Scheme (MCS), technologies under 50kWe or 300kWh must be certified.
- Combined Heat and Power (CHP) schemes above 50kWe must be certified under the CHPQA standard.
- All technologies must be accounted for by SAP.

CHP schemes fuelled by mains gas are eligible to contribute to performance against this issue. Where these schemes are above 50kWe they must be certified under the CHPQA.

It is the responsibility of the Accredited OCDEA and Code Assessor to ensure all technologies use in the calculation are appropriate before awarding credits.

# Predicted Energy Assessment



A-G-02  
49-51 Beulah Hill


Sada Unit Ref: A0-A6

Dwelling type:  
Date of assessment:  
Produced by:  
Total floor area:

Ground floor Flat  
12 March 2019  
Aymon Winter  
65.73 m<sup>2</sup>

This is a Predicted Energy Assessment for a property which is not yet complete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, an Energy Performance Certificate is required providing information about the energy performance of the completed property.

Energy performance has been assessed using the SAP 2012 methodology and is rated in terms of the energy use per square metre of floor area, energy efficiency based on fuel costs and environmental impact based on carbon dioxide (CO<sub>2</sub>) emissions.

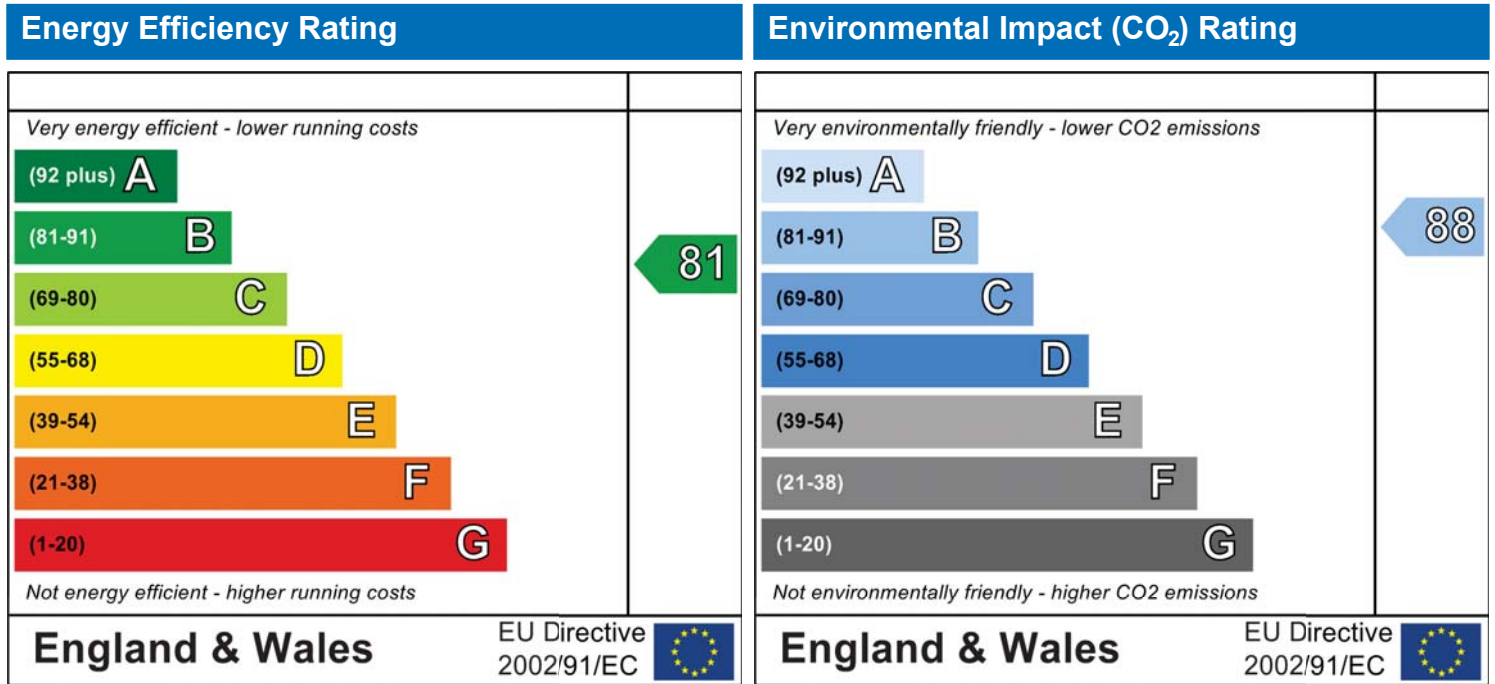

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

## Property Details: 01-19-73120 A-G-02 PL1

**Address:** A-G-02, 49-51 Beulah Hill  
**Located in:** England  
**Region:** Thames valley  
**UPRN:**  
**Date of assessment:** 12 March 2019  
**Date of certificate:** 25 March 2019  
**Assessment type:** New dwelling design stage  
**Transaction type:** New dwelling  
**Tenure type:** Unknown  
**Related party disclosure:** No related party  
**Thermal Mass Parameter:** Calculated 150.27  
**Water use <= 125 litres/person/day:** True  
**PCDF Version:** 440

## Property description:

**Dwelling type:** Flat  
**Detachment:**  
**Year Completed:** 2013  
**Floor Location:** **Floor area:** **Storey height:**  
 Floor 0 65.73 m<sup>2</sup> 2.56 m  
**Living area:** 29.96 m<sup>2</sup> (fraction 0.456)  
**Front of dwelling faces:** South West

## Opening types:

Name:	Source:	Type:	Glazing:	Argon:	Frame:
Front Door	Manufacturer	Solid			PVC-U
Rear Elev	Manufacturer	Windows	low-E, En = 0.05, soft coat	Yes	Metal
Side Elev	Manufacturer	Windows	low-E, En = 0.05, soft coat	Yes	Metal
Rear Elev with Balcony above	Manufacturer	Windows	low-E, En = 0.05, soft coat	Yes	Metal
Side Elev	Manufacturer	Windows	low-E, En = 0.05, soft coat	Yes	Metal

Name:	Gap:	Frame Factor:	g-value:	U-value:	Area:	No. of Openings:
Front Door	mm	0.7	0	1.4	2.12	1
Rear Elev	16mm or more	0.8	0.4	1.4	5.94	1
Side Elev	16mm or more	0.8	0.4	1.4	6.1	1
Rear Elev with Balcony above	16mm or more	0.8	0.4	1.4	6.41	1
Side Elev	16mm or more	0.8	0.4	1.4	4.35	1

Name:	Type-Name:	Location:	Orient:	Width:	Height:
Front Door		Wall to Corridor	South West	0	0
Rear Elev		External Wall	North East	0	0
Side Elev		External Wall	North West	0	0
Rear Elev with Balcony above		External Wall	North East	2.68	2.39
Side Elev		External Wall	South East	0	0

**Overshading:** Average or unknown

## Opaque Elements:

Type:	Gross area:	Openings:	Net area:	U-value:	Ru value:	Curtain wall:	Kappa:
<b>External Elements</b>							
External Wall	56.45	22.8	33.65	0.13	0	False	14
Wall to Corridor	4.74	2.12	2.62	0.26	0.43	False	14
Wall to Lift Shaft	17.15	0	17.15	0.26	0.9	False	17
Roof to Terrace	4.19	0	4.19	0.14	0		9

# SAP Input

Ground Floor	40.03	0.11	110
Exposed Floor over corridor in store	7.49	0.13	75
<b>Internal Elements</b>			
IW Stud	136		9
<b>Party Elements</b>			
Party Wall	13.82		20
Party Ceiling	61.55		30
Party Floor	18.21		40

## Thermal bridges:

Thermal bridges:	User-defined (individual PSI-values) Y-Value = 0.1326			
	<b>Length</b>	<b>Psi-value</b>		
	11.82	0.3	E2	Other lintels (including other steel lintels)
	6.31	0.04	E3	Sill
	29.36	0.05	E4	Jamb
	20.13	0.16	E5	Ground floor (normal)
	4.67	0.07	E19	Ground floor (inverted)
	5.34	0.32	E20	Exposed floor (normal)
	5.66	0.32	E21	Exposed floor (inverted)
	34.17	0.07	E7	Party floor between dwellings (in blocks of flats)
	4.45	0.28	E15	Flat roof with parapet
	10.24	0.09	E16	Corner (normal)
	2.56	-0.09	E17	Corner (inverted – internal area greater than external area)
	2.56	0.06	E18	Party wall between dwellings
	2.56	0.12	E25	Staggered party wall between dwellings c
	10.07	0	P3	Intermediate floor between dwellings (in blocks of flats)
	0.73	0.16	P7	Exposed floor (normal)

## Ventilation:

Pressure test:	Yes (As designed)
Ventilation:	Centralised whole house extract
	Number of wet rooms: Kitchen + 2
	Ductwork: , rigid
	Approved Installation Scheme: False
Number of chimneys:	0
Number of open flues:	0
Number of fans:	0
Number of passive stacks:	0
Number of sides sheltered:	2
Pressure test:	5

## Main heating system:

Main heating system:	Boiler systems with radiators or underfloor heating
	Gas boilers and oil boilers
	Fuel: mains gas
	Info Source: Boiler Database
	Database: (rev 440, product index 017558) Efficiency: Winter 86.7 % Summer: 90.0
	Brand name: Worcester
	Model: Greenstar
	Model qualifier: 34CDi Classic ErP
	(Combi boiler)
	Systems with radiators
	Central heating pump : 2013 or later
	Design flow temperature: Unknown
	Boiler interlock: Yes
	Delayed start

## Main heating Control:

# SAP Input

Main heating Control: Programmer, room thermostat and TRVs  
Control code: 2106

## Secondary heating system:

Secondary heating system: None

## Water heating:

Water heating: From main heating system  
Water code: 901  
Fuel :mains gas  
No hot water cylinder  
Solar panel: False

## Others:

Electricity tariff: Standard Tariff  
In Smoke Control Area: Unknown  
Conservatory: No conservatory  
Low energy lights: 100%  
Terrain type: Low rise urban / suburban  
EPC language: English  
Wind turbine: No  
Photovoltaics: Photovoltaic 1  
Installed Peak power: 0.98  
Tilt of collector: Horizontal  
Overshading: None or very little  
Collector Orientation: South

Assess Zero Carbon Home: No

# SAP WorkSheet: New dwelling design stage

## User Details:

**Assessor Name:** Aymon Winter      **Stroma Number:** STRO014511  
**Software Name:** Stroma FSAP 2012      **Software Version:** Version: 1.0.4.16

Property Address: 01-19-73120 A-G-02 PL1

**Address :** A-G-02, 49-51 Beulah Hill

### 1. Overall dwelling dimensions:

	Area(m <sup>2</sup> )	Av. Height(m)	Volume(m <sup>3</sup> )
Ground floor	65.73 (1a)	2.56 (2a)	168.27 (3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	65.73 (4)		
Dwelling volume		(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =	168.27 (5)

### 2. Ventilation rate:

	main heating	secondary heating	other	total	m <sup>3</sup> per hour
Number of chimneys	0	0	0	0	0 (6a)
Number of open flues	0	0	0	0	0 (6b)
Number of intermittent fans				0	0 (7a)
Number of passive vents				0	0 (7b)
Number of flueless gas fires				0	0 (7c)

### Air changes per hour

Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
<i>If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)</i>			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction <i>if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35</i>			0 (11)
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20] + (8), otherwise (18) = (16)			0.25 (18)
<i>Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used</i>			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.21 (21)

Infiltration rate modified for monthly wind speed

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Monthly average wind speed from Table 7

(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
--------	-----	---	-----	-----	-----	-----	-----	-----	---	-----	-----	-----

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18
---------	------	------	------	-----	------	------	------	------	---	------	------	------



Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.27	0.27	0.26	0.23	0.23	0.2	0.2	0.2	0.21	0.23	0.24	0.25
------	------	------	------	------	-----	-----	-----	------	------	------	------

Calculate effective air change rate for the applicable case

If mechanical ventilation:

0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) x Fmv (equation (N5)) , otherwise (23b) = (23a)

0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) =

0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) x [1 - (23c) ÷ 100]

(24a)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24b)

c) If whole house extract ventilation or positive input ventilation from outside

if (22b)m < 0.5 x (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 x (23b)

(24c)m= 0.52 0.52 0.51 0.5 0.5 0.5 0.5 0.5 0.5 0.5 0.5 0.5 (24c)

d) If natural ventilation or whole house positive input ventilation from loft

if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m<sup>2</sup> x 0.5]

(24d)m= 0 0 0 0 0 0 0 0 0 0 0 0 (24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m= 0.52 0.52 0.51 0.5 0.5 0.5 0.5 0.5 0.5 0.5 0.5 0.5 (25)

**3. Heat losses and heat loss parameter:**

ELEMENT	Gross area (m <sup>2</sup> )	Openings m <sup>2</sup>	Net Area A ,m <sup>2</sup>	U-value W/m <sup>2</sup> K	A X U (W/K)	k-value kJ/m <sup>2</sup> ·K	A X k kJ/K
Doors			2.12	1.4	2.968		(26)
Windows Type 1			5.94	$1/[1/(1.4)+0.04]$	7.87		(27)
Windows Type 2			6.1	$1/[1/(1.4)+0.04]$	8.09		(27)
Windows Type 3			6.41	$1/[1/(1.4)+0.04]$	8.5		(27)
Windows Type 4			4.35	$1/[1/(1.4)+0.04]$	5.77		(27)
Floor Type 1			40.03	0.11	4.4033	110	4403.3 (28)
Floor Type 2			7.49	0.13	0.9736999	75	561.75 (28)
Walls Type1	56.45	22.8	33.65	0.13	4.37	14	471.1 (29)
Walls Type2	4.74	2.12	2.62	0.23	0.61	14	36.68 (29)
Walls Type3	17.15	0	17.15	0.21	3.61	17	291.55 (29)
Roof	4.19	0	4.19	0.14	0.59	9	37.71 (30)
Total area of elements, m <sup>2</sup>			130.05				(31)
Party wall			13.82	0	0	20	276.4 (32)
Party floor			18.21			40	728.4 (32a)
Party ceiling			61.55			30	1846.5 (32b)
Internal wall **			136			9	1224 (32c)

\* for windows and roof windows, use effective window U-value calculated using formula  $1/[(1/U\text{-value})+0.04]$  as given in paragraph 3.2

\*\* include the areas on both sides of internal walls and partitions

Fabric heat loss, W/K = S (A x U) (26)...(30) + (32) = 47.76 (33)

Heat capacity Cm = S(A x k ) ((28)...(30) + (32) + (32a)...(32e) = 9877.39 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m<sup>2</sup>K = (34) ÷ (4) = 150.27 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f

# SAP WorkSheet: New dwelling design stage

can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 17.24 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 65 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 x (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	28.93	28.63	28.34	27.76	27.76	27.76	27.76	27.76	27.76	27.76	27.76	27.76	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	93.93	93.63	93.34	92.76	92.76	92.76	92.76	92.76	92.76	92.76	92.76	92.76	
Average = Sum(39) <sub>1...12</sub> /12=												92.98 (39)	

Heat loss parameter (HLP), W/m<sup>2</sup>K (40)m = (39)m + (4)

(40)m=	1.43	1.42	1.42	1.41	1.41	1.41	1.41	1.41	1.41	1.41	1.41	1.41	
Average = Sum(40) <sub>1...12</sub> /12=												1.41 (40)	

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

## 4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.14 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)<sup>2</sup>)] + 0.0013 x (TFA -13.9)

if TFA ≤ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 84.98 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more than 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	93.48	90.08	86.68	83.28	79.88	76.48	76.48	79.88	83.28	86.68	90.08	93.48	
Total = Sum(44) <sub>1...12</sub> =												1019.78 (44)	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	138.63	121.24	125.11	109.08	104.66	90.32	83.69	96.04	97.18	113.26	123.63	134.25	
Total = Sum(45) <sub>1...12</sub> =												1337.09 (45)	

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m= 

20.79	18.19	18.77	16.36	15.7	13.55	12.55	14.41	14.58	16.99	18.54	20.14
-------	-------	-------	-------	------	-------	-------	-------	-------	-------	-------	-------

 (46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

# SAP WorkSheet: New dwelling design stage

Energy lost from water storage, kWh/year  $(47) \times (51) \times (52) \times (53) =$ 

0
0

 (54)  
 Enter (50) or (54) in (55) 

0
---

 (55)

Water storage loss calculated for each month  $((56)m = (55) \times (41)m$   
 (56)m= 

0	0	0	0	0	0	0	0	0	0	0	0
---	---	---	---	---	---	---	---	---	---	---	---

 (56)

If cylinder contains dedicated solar storage,  $(57)m = (56)m \times [(50) - (H11)] \div (50)$ , else  $(57)m = (56)m$  where (H11) is from Appendix H

(57)m= 

0	0	0	0	0	0	0	0	0	0	0	0
---	---	---	---	---	---	---	---	---	---	---	---

 (57)

Primary circuit loss (annual) from Table 3 

0
---

 (58)

Primary circuit loss calculated for each month  $(59)m = (58) \div 365 \times (41)m$   
 (modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)  
 (59)m= 

0	0	0	0	0	0	0	0	0	0	0	0
---	---	---	---	---	---	---	---	---	---	---	---

 (59)

Combi loss calculated for each month  $(61)m = (60) \div 365 \times (41)m$   
 (61)m= 

35.75	32.26	35.67	34.46	35.57	34.38	35.5	35.55	34.43	35.63	34.54	35.73
-------	-------	-------	-------	-------	-------	------	-------	-------	-------	-------	-------

 (61)

Total heat required for water heating calculated for each month  $(62)m = 0.85 \times (45)m + (46)m + (57)m + (59)m + (61)m$   
 (62)m= 

174.38	153.5	160.78	143.54	140.24	124.7	119.19	131.58	131.61	148.89	158.17	169.99
--------	-------	--------	--------	--------	-------	--------	--------	--------	--------	--------	--------

 (62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)  
 (add additional lines if FGHRHS and/or WWHRHS applies, see Appendix G)  
 (63)m= 

0	0	0	0	0	0	0	0	0	0	0	0
---	---	---	---	---	---	---	---	---	---	---	---

 (63)

Output from water heater  
 (64)m= 

174.38	153.5	160.78	143.54	140.24	124.7	119.19	131.58	131.61	148.89	158.17	169.99
--------	-------	--------	--------	--------	-------	--------	--------	--------	--------	--------	--------

  
Output from water heater (annual)<sub>1...12</sub>

1756.56
---------

 (64)

Heat gains from water heating, kWh/month  $0.25 \times [0.85 \times (45)m + (61)m] + 0.8 \times [(46)m + (57)m + (59)m]$   
 (65)m= 

55.03	48.38	50.52	44.88	43.69	38.63	36.7	40.82	40.92	46.57	49.74	53.57
-------	-------	-------	-------	-------	-------	------	-------	-------	-------	-------	-------

 (65)  
 include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

## 5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts  
 (66)m= 

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
128.29	128.29	128.29	128.29	128.29	128.29	128.29	128.29	128.29	128.29	128.29	128.29

 (66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5  
 (67)m= 

41.71	37.04	30.13	22.81	17.05	14.39	15.55	20.22	27.13	34.45	40.21	42.87
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

 (67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5  
 (68)m= 

279.3	282.2	274.9	259.35	239.72	221.28	208.95	206.05	213.36	228.91	248.53	266.98
-------	-------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------

 (68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5  
 (69)m= 

49.97	49.97	49.97	49.97	49.97	49.97	49.97	49.97	49.97	49.97	49.97	49.97
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

 (69)

Pumps and fans gains (Table 5a)  
 (70)m= 

3	3	3	3	3	3	3	3	3	3	3	3
---	---	---	---	---	---	---	---	---	---	---	---

 (70)

Losses e.g. evaporation (negative values) (Table 5)  
 (71)m= 

-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53	-85.53
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

 (71)

Water heating gains (Table 5)  
 (72)m= 

73.97	71.99	67.9	62.34	58.73	53.65	49.33	54.86	56.83	62.59	69.09	72.01
-------	-------	------	-------	-------	-------	-------	-------	-------	-------	-------	-------

 (72)

**Total internal gains =**  $(66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m$   
 (73)m= 

490.71	486.97	468.66	440.23	411.23	385.05	369.57	376.86	393.06	421.68	453.56	477.58
--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------

 (73)

## 6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

# SAP WorkSheet: New dwelling design stage



Orientation:	Access Factor Table 6d		Area m <sup>2</sup>		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)
Northeast 0.9x	0.77	x	5.94	x	11.28	x	0.4	x	0.8	=	14.86 (75)
Northeast 0.9x	0.77	x	6.41	x	11.28	x	0.4	x	0.8	=	16.04 (75)
Northeast 0.9x	0.77	x	5.94	x	22.97	x	0.4	x	0.8	=	30.25 (75)
Northeast 0.9x	0.77	x	6.41	x	22.97	x	0.4	x	0.8	=	32.65 (75)
Northeast 0.9x	0.77	x	5.94	x	41.38	x	0.4	x	0.8	=	54.51 (75)
Northeast 0.9x	0.77	x	6.41	x	41.38	x	0.4	x	0.8	=	58.82 (75)
Northeast 0.9x	0.77	x	5.94	x	67.96	x	0.4	x	0.8	=	89.52 (75)
Northeast 0.9x	0.77	x	6.41	x	67.96	x	0.4	x	0.8	=	96.6 (75)
Northeast 0.9x	0.77	x	5.94	x	91.35	x	0.4	x	0.8	=	120.33 (75)
Northeast 0.9x	0.77	x	6.41	x	91.35	x	0.4	x	0.8	=	129.85 (75)
Northeast 0.9x	0.77	x	5.94	x	97.38	x	0.4	x	0.8	=	128.28 (75)
Northeast 0.9x	0.77	x	6.41	x	97.38	x	0.4	x	0.8	=	138.43 (75)
Northeast 0.9x	0.77	x	5.94	x	91.1	x	0.4	x	0.8	=	120 (75)
Northeast 0.9x	0.77	x	6.41	x	91.1	x	0.4	x	0.8	=	129.5 (75)
Northeast 0.9x	0.77	x	5.94	x	72.63	x	0.4	x	0.8	=	95.67 (75)
Northeast 0.9x	0.77	x	6.41	x	72.63	x	0.4	x	0.8	=	103.24 (75)
Northeast 0.9x	0.77	x	5.94	x	50.42	x	0.4	x	0.8	=	66.42 (75)
Northeast 0.9x	0.77	x	6.41	x	50.42	x	0.4	x	0.8	=	71.67 (75)
Northeast 0.9x	0.77	x	5.94	x	28.07	x	0.4	x	0.8	=	36.97 (75)
Northeast 0.9x	0.77	x	6.41	x	28.07	x	0.4	x	0.8	=	39.9 (75)
Northeast 0.9x	0.77	x	5.94	x	14.2	x	0.4	x	0.8	=	18.7 (75)
Northeast 0.9x	0.77	x	6.41	x	14.2	x	0.4	x	0.8	=	20.18 (75)
Northeast 0.9x	0.77	x	5.94	x	9.21	x	0.4	x	0.8	=	12.14 (75)
Northeast 0.9x	0.77	x	6.41	x	9.21	x	0.4	x	0.8	=	13.1 (75)
Southeast 0.9x	0.77	x	4.35	x	36.79	x	0.4	x	0.8	=	35.49 (77)
Southeast 0.9x	0.77	x	4.35	x	62.67	x	0.4	x	0.8	=	60.46 (77)
Southeast 0.9x	0.77	x	4.35	x	85.75	x	0.4	x	0.8	=	82.72 (77)
Southeast 0.9x	0.77	x	4.35	x	106.25	x	0.4	x	0.8	=	102.5 (77)
Southeast 0.9x	0.77	x	4.35	x	119.01	x	0.4	x	0.8	=	114.8 (77)
Southeast 0.9x	0.77	x	4.35	x	118.15	x	0.4	x	0.8	=	113.97 (77)
Southeast 0.9x	0.77	x	4.35	x	113.91	x	0.4	x	0.8	=	109.88 (77)
Southeast 0.9x	0.77	x	4.35	x	104.39	x	0.4	x	0.8	=	100.7 (77)
Southeast 0.9x	0.77	x	4.35	x	92.85	x	0.4	x	0.8	=	89.57 (77)
Southeast 0.9x	0.77	x	4.35	x	69.27	x	0.4	x	0.8	=	66.82 (77)
Southeast 0.9x	0.77	x	4.35	x	44.07	x	0.4	x	0.8	=	42.51 (77)
Southeast 0.9x	0.77	x	4.35	x	31.49	x	0.4	x	0.8	=	30.37 (77)
Northwest 0.9x	0.77	x	6.1	x	11.28	x	0.4	x	0.8	=	15.26 (81)
Northwest 0.9x	0.77	x	6.1	x	22.97	x	0.4	x	0.8	=	31.07 (81)
Northwest 0.9x	0.77	x	6.1	x	41.38	x	0.4	x	0.8	=	55.97 (81)

# SAP WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	6.1	x	67.96	x	0.4	x	0.8	=	91.93	(81)
Northwest 0.9x	0.77	x	6.1	x	91.35	x	0.4	x	0.8	=	123.57	(81)
Northwest 0.9x	0.77	x	6.1	x	97.38	x	0.4	x	0.8	=	131.74	(81)
Northwest 0.9x	0.77	x	6.1	x	91.1	x	0.4	x	0.8	=	123.24	(81)
Northwest 0.9x	0.77	x	6.1	x	72.63	x	0.4	x	0.8	=	98.25	(81)
Northwest 0.9x	0.77	x	6.1	x	50.42	x	0.4	x	0.8	=	68.21	(81)
Northwest 0.9x	0.77	x	6.1	x	28.07	x	0.4	x	0.8	=	37.97	(81)
Northwest 0.9x	0.77	x	6.1	x	14.2	x	0.4	x	0.8	=	19.2	(81)
Northwest 0.9x	0.77	x	6.1	x	9.21	x	0.4	x	0.8	=	12.46	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m ... (82)m

(83)m=	81.66	154.43	252.02	380.54	488.54	512.42	482.62	397.85	295.86	181.66	100.6	68.07	(83)
--------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	-------	-------	------

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	572.37	641.4	720.68	820.76	899.77	897.47	852.19	774.72	688.92	603.33	554.16	545.66	(84)
--------	--------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	------

## 7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.97	0.95	0.92	0.85	0.73	0.58	0.45	0.5	0.72	0.89	0.95	0.97	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.03	19.26	19.66	20.17	20.6	20.86	20.95	20.93	20.72	20.17	19.51	18.99	(87)
--------	-------	-------	-------	-------	------	-------	-------	-------	-------	-------	-------	-------	------

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.74	19.74	19.75	19.75	19.75	19.75	19.75	19.75	19.75	19.75	19.75	19.75	(88)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.96	0.94	0.9	0.82	0.68	0.49	0.33	0.39	0.64	0.86	0.94	0.96	(89)
--------	------	------	-----	------	------	------	------	------	------	------	------	------	------

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	17.99	18.22	18.61	19.1	19.48	19.68	19.74	19.73	19.59	19.11	18.48	17.97	(90)
--------	-------	-------	-------	------	-------	-------	-------	-------	-------	-------	-------	-------	------

fLA = Living area ÷ (4) = 0.46 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.46	18.69	19.09	19.59	19.99	20.22	20.29	20.28	20.1	19.59	18.95	18.43	(92)
--------	-------	-------	-------	-------	-------	-------	-------	-------	------	-------	-------	-------	------

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.31	18.54	18.94	19.44	19.84	20.07	20.14	20.13	19.95	19.44	18.8	18.28	(93)
--------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	------	-------	------

## 8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Utilisation factor for gains, hm:

(94)m=	0.95	0.93	0.89	0.81	0.68	0.51	0.37	0.42	0.65	0.85	0.93	0.96	(94)
--------	------	------	------	------	------	------	------	------	------	------	------	------	------

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	543.5	596.71	642.13	664.39	611.44	462.06	316.35	327.58	450.34	512.42	514.64	521.17	(95)
--------	-------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	--------	------

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
--------	-----	-----	-----	-----	------	------	------	------	------	------	-----	-----	------

Heat loss rate for mean internal temperature, Lm , W = [(39)m x [(93)m – (96)m ]

(97)m=	1316.25	1277.2	1160.84	977.71	755.35	507.2	328.5	345.72	543.12	820.07	1085.48	1306.51	(97)
--------	---------	--------	---------	--------	--------	-------	-------	--------	--------	--------	---------	---------	------

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	574.93	457.29	385.92	225.59	107.07	0	0	0	0	228.9	411	584.29		
												Total per year (kWh/year) = Sum(98) <sub>1...5,9...12</sub> =	2974.99	(98)

Space heating requirement in kWh/m <sup>2</sup> /year	45.26	(99)
---	-------	------

**9a. Energy requirements – Individual heating systems including micro-CHP**

**Space heating:**

Fraction of space heat from secondary/supplementary system		0	(201)
Fraction of space heat from main system(s)	(202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1		90	(206)
Efficiency of secondary/supplementary heating system, %		0	(208)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	----------

Space heating requirement (calculated above)	574.93	457.29	385.92	225.59	107.07	0	0	0	0	228.9	411	584.29		
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)	
	638.81	508.1	428.8	250.65	118.97	0	0	0	0	254.33	456.67	649.21		
												Total (kWh/year) = Sum(211) <sub>1...5,10...12</sub> =	3305.54	(211)

Space heating fuel (secondary), kWh/month														
= {[(98)m x (201)] } x 100 ÷ (208)														
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0		
												Total (kWh/year) = Sum(215) <sub>1...5,10...12</sub> =	0	(215)

**Water heating**

Output from water heater (calculated above)	174.38	153.5	160.78	143.54	140.24	124.7	119.19	131.58	131.61	148.89	158.17	169.99		
Efficiency of water heater													86.7	(216)
(217)m=	89.21	89.15	89	88.69	88.1	86.7	86.7	86.7	86.7	88.67	89.06	89.23		
Fuel for water heating, kWh/month														
(219)m = (64)m x 100 ÷ (217)m														
(219)m=	195.47	172.19	180.65	161.85	159.18	143.82	137.47	151.77	151.8	167.91	177.6	190.49		
												Total = Sum(219a) <sub>1...12</sub> =	1990.21	(219)

**Annual totals**

		<b>kWh/year</b>	<b>kWh/year</b>
Space heating fuel used, main system 1			3305.54
Water heating fuel used			1990.21
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside		43.11	(230a)
central heating pump:		30	(230c)
boiler with a fan-assisted flue		45	(230e)
Total electricity for the above, kWh/year	sum of (230a)...(230g) =		118.11
Electricity for lighting			294.63
Electricity generated by PVs			-745.28

## 10a. Fuel costs - individual heating systems:

	Fuel kWh/year	Fuel Price (Table 12)	Fuel Cost £/year
Space heating - main system 1	(211) x	3.48	115.03 (240)
Space heating - main system 2	(213) x	0	0 (241)
Space heating - secondary	(215) x	13.19	0 (242)
Water heating cost (other fuel)	(219)	3.48	69.26 (247)
Pumps, fans and electric keep-hot	(231)	13.19	15.58 (249)
(if off-peak tariff, list each of (230a) to (230g) separately as applicable and apply fuel price according to Table 12a)			
Energy for lighting	(232)	13.19	38.86 (250)
Additional standing charges (Table 12)			120 (251)
	one of (233) to (235) x	13.19	0 (252)
Appendix Q items: repeat lines (253) and (254) as needed			
<b>Total energy cost</b>	(245)...(247) + (250)...(254) =		358.73 (255)

## 11a. SAP rating - individual heating systems

Energy cost deflator (Table 12)		0.42 (256)
Energy cost factor (ECF)	$[(255) \times (256)] \div [(4) + 45.0] =$	1.36 (257)
<b>SAP rating (Section 12)</b>		81.02 (258)

## 12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	Emission factor kg CO2/kWh	Emissions kg CO2/year
Space heating (main system 1)	(211) x	0.216	714 (261)
Space heating (secondary)	(215) x	0.519	0 (263)
Water heating	(219) x	0.216	429.88 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1143.88 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	61.3 (267)
Electricity for lighting	(232) x	0.519	152.91 (268)
Energy saving/generation technologies Item 1		0.519	-386.8 (269)
Total CO2, kg/year		sum of (265)...(271) =	971.29 (272)
<b>CO2 emissions per m²</b>		(272) ÷ (4) =	14.78 (273)
El rating (section 14)			88 (274)

## 13a. Primary Energy

	Energy kWh/year	Primary factor	P. Energy kWh/year
Space heating (main system 1)	(211) x	1.22	4032.76 (261)

# SAP WorkSheet: New dwelling design stage



Space heating (secondary)	(215) x	3.07	=	0	(263)
Energy for water heating	(219) x	1.22	=	2428.05	(264)
Space and water heating	(261) + (262) + (263) + (264) =			6460.81	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	3.07	=	362.6	(267)
Electricity for lighting	(232) x	0	=	904.51	(268)
Energy saving/generation technologies Item 1		3.07	=	-2288.02	(269)
'Total Primary Energy	sum of (265)...(271) =			5439.9	(272)
<b>Primary energy kWh/m<sup>2</sup>/year</b>	(272) ÷ (4) =			82.76	(273)



# SAP 2012 Overheating Assessment

Calculated by Stroma FSAP 2012 program, produced and printed on 25 March 2019

Property Details: 01-19-73120 A-G-02 PL1

<b>Dwelling type:</b>	Flat
<b>Located in:</b>	England
<b>Region:</b>	Thames valley
<b>Cross ventilation possible:</b>	Yes
<b>Number of storeys:</b>	1
<b>Front of dwelling faces:</b>	South West
<b>Overshading:</b>	Average or unknown
<b>Overhangs:</b>	None
<b>Thermal mass parameter:</b>	Calculated 150.27
<b>Night ventilation:</b>	False
<b>Blinds, curtains, shutters:</b>	
<b>Ventilation rate during hot weather (ach):</b>	3 ( Windows open half the time)

## Overheating Details:

<b>Summer ventilation heat loss coefficient:</b>	166.59	(P1)
<b>Transmission heat loss coefficient:</b>	65	
<b>Summer heat loss coefficient:</b>	231.59	(P2)

## Overhangs:

Orientation:	Ratio:	Z_overhangs:
North East (Rear Elev)	0	1
North West (Side Elev)	0	1
North East (Rear Elev with Balcony above)	0.42	0.85
South East (Side Elev)	0	1

## Solar shading:

Orientation:	Z blinds:	Solar access:	Overhangs:	Z summer:	
North East (Rear Elev)	1	0.9	1	0.9	(P8)
North West (Side Elev)	1	0.9	1	0.9	(P8)
North East (Rear Elev with Balcony above)	0.9	0.9	0.85	0.75	(P8)
South East (Side Elev)	1	0.9	1	0.9	(P8)

## Solar gains:

Orientation	Area	Flux	g_	FF	Shading	Gains
North East (Rear Elev)	0.9 x 5.94	98.85	0.4	0.8	0.9	152.19
North West (Side Elev)	0.9 x 6.1	98.85	0.4	0.8	0.9	156.29
North East (Rear Elev with Balcony above)	0.9 x 6.11	98.85	0.4	0.8	0.75	136.19
South East (Side Elev)	0.9 x 4.35	119.92	0.4	0.8	0.9	135.21
					<b>Total</b>	<b>579.87 (P3/P4)</b>

## Internal gains:

	June	July	August
Internal gains	382.05	366.57	373.86
Total summer gains	1004.02	946.44	863.79 (P5)
Summer gain/loss ratio	4.34	4.09	3.73 (P6)
Mean summer external temperature (Thames valley)	16	17.9	17.8
Thermal mass temperature increment	0.95	0.95	0.95
Threshold temperature	21.28	22.93	22.48 (P7)
<b>Likelihood of high internal temperature</b>	<b>Slight</b>	<b>Medium</b>	<b>Medium</b>

# SAP 2012 Overheating Assessment

Assessment of likelihood of high internal temperature: Medium